

Lead in Drinking Water Testing – Willink Middle School September 24, 2025

Location:

Webster Central School District
1028 Ridge Road, Suite 12
Webster, New York 14580



LaBella Project No.

2251107

October 22, 2025



Table of Contents

1.0	BACKGROUND	1
2.0	SAMPLING PROCEDURES	1
3.0	RESULTS	2
3.1	<i>Total Water Sample Summary</i>	2
4.0	RESPONSE MEASURES	2
4.1	<i>Immediate Response</i>	2
4.2	<i>Short-Term Control Measures</i>	3
4.3	<i>Permanent Control Measures</i>	3
5.0	REPORTING AND RECORD KEEPING	3

Appendices

Appendix A – Detailed Results Spreadsheet

Appendix B – Laboratory Analytical Results

Appendix C – Licenses and Certifications



1.0 BACKGROUND

LaBella Associates, D.P.C. (LaBella) sampled potable water outlets throughout the Webster Central School District (WCSD) in accordance with Subpart 67-4 of Title 10 of the New York State Codes, Rules, and Regulations (Subpart 67-4). Under Subpart 67-4, “all school districts and boards of cooperative educational services are required to test potable water for lead contamination, and to develop and implement a lead remediation plan, where applicable.”

Lead contamination is a significant public health concern. Lead has been linked to various harmful conditions such as central nervous system and kidney damage. Children, especially those under the age of 6, are particularly susceptible to the toxic effects of lead. There is no known safe level of lead in blood, and the US Environmental Protection Agency (USEPA) has set a Maximum Contaminant Level Goal of zero. As of 2022, Subpart 67-4 establishes an action level of 5 parts per billion (ppb) in school drinking water. If test results exceed this level, the district must undertake remedial action.

The Subpart 67-4 testing requirement was first promulgated under emergency legislation in 2016, and subsequently signed into permanent law. Subsequently, Senate Bill S2122A was signed into law on December 22, 2022, changing various components of Subpart 67-4. Key revisions to the standard include a reduced action level down to 5 parts per billion (ppb), and requires that testing be performed every three years. The next round of sampling reports are due by the end of 2025. This report has been designed to fulfill the initial testing and reporting requirements outlined in Subpart 67-4.

LaBella conducted the initial water sampling on September 24, 2025 at Willink Middle School located at 900 Publishers Parkway in Webster, NY. Outlets that were selected for sampling include drinking fountains, bottle fillers, kitchen sinks, classroom sinks, medical office sinks, and ice machines. Outlets categorically excluded from testing included laboratory sinks, bathroom sinks, art room sinks, single-handle faucets, showers, toilets, janitor’s sinks, and mechanical room outlets. Typically, excluded outlets are capable of being isolated by custodial staff, and will require warning signs to prohibit consumption.

2.0 SAMPLING PROCEDURES

The target water outlets were left to stagnate for a period of 8 to 18 hours prior to the start of the sampling. The water conditions were reported to be representative of normal consumptive patterns with building occupancy controlled during stagnation and sampling periods.

In accordance with Subpart 67-4 requirements, sampling was limited to “first-draw” samples. A volume of the first 250 mL of water was taken from each cold-water outlet in the sampling inventory.

The samples were then promptly packaged and shipped to a NYS Department of Health Environmental Laboratory Approval Program (ELAP) accredited laboratory. Samples were analyzed utilizing EPA environmental analysis method 200.8 for lead in potable water. Results from the sampling rounds were then delivered to WCSD.



3.0 RESULTS

3.1 Total Water Sample Summary

The following table summarizes the results from the September 24, 2025 sampling round:

Willink Middle School – September 24, 2025 Water Sample Summary		
Building	Number of Total Samples	Number of Outlets above Action Level
Willink Middle School	42	1

Based on laboratory analyses of the samples collected, a single outlet was determined to exceed the Subpart 67-4 action level of 5 micrograms per liter ($\mu\text{g/L}$). A summary of this specific outlet is described below:

Willink Middle School Samples Exceeding 5 $\mu\text{g/L}$ (ppb) Reporting Threshold			
Sample ID	Sample Description	Outlet Type	Result ($\mu\text{g/L}$)
WMS-01-CR-IN-D106-T	Classroom D106	Tap	11.9

For a full list of outlets sampled, see Appendix A.

4.0 RESPONSE MEASURES

According to section Subpart 67-4.4 “Response” of the regulation, school districts shall prohibit the use of all outlets which exceed the 5 ppb ($\mu\text{g/L}$) action level. These outlets shall remain out of service until a lead remediation plan is implemented to reduce the level of lead, and resampling indicates lead levels at or below the action level. While the outlet is out of service, the district must supply an appropriate amount of potable water for drinking or cooking to building occupants.

The following measures are meant to be options for the district to consider. If a outlet is found to have exceeded the Action Level, an Immediate Response must be implemented. From there a Short-Term Control Measure may be enough to mitigate the hazard, with additional sampling conducted to confirm the measures’ effectiveness. Permanent Control Measures may be considered if the outlet continues to show elevated levels. Additional samples shall be collected after any control measure is put in place.

4.1 Immediate Response

- A. Shut Off Problem Outlets – If initial sample results exceed the Action Level, the outlet can be shut off or disconnected until the problem is resolved.
- B. Post “Non-Potable Water” at Problem Outlets – If the outlet is routinely used for purposes other than human ingestion (i.e. hand washing), clear signage can be posted to notify building occupants that the outlet is not to be used for drinking or cooking. This shall remain until further sampling proves the contaminant levels are below the Action Level.

Special Note – this signage shall also be posted on any outlet that was categorically excluded from testing and that cannot be isolated by custodial staff.



- C. Provide Alternate Drinking Water Sources – If the removal of an outlet drastically affects the drinking or cooking water supply of occupants, the district shall supply water by other means. This shall be in the form of water bottles, water coolers, or other methods to bring in outside water.

4.2 Short-Term Control Measures

- A. Post “Non-Potable Water” at Problem Outlets – This method may be used as a continual short-term control measure. The sign may be removed only when additional sampling confirms that contaminant levels within the outlet are below the Action Level. Maintenance or custodial staff shall perform periodic inspections to ensure the signage remains in place.
- B. Provide Filters at Problem Outlets – Point-of-use (POU) units are commercially available and can be effective in removing lead contaminants. The district shall oversee the installation and routine maintenance of these outlets, as well as keep records on their location and maintenance history.

4.3 Permanent Control Measures

- A. Provide Filters at Problem Outlets – POU filters can serve as long-term or permanent control measures. The district shall create maintenance schedules, conduct follow-up water sampling, and replace the filters as needed.
- B. Replacement of Problem Outlets – This can involve the removal of the outlet as well as any upstream plumbing components (e.g. valves, leaded solder). New outlets to be installed shall be certified lead-free.
- C. Pipe Replacement – Lead pipes within school buildings and portions of lead service lines can be replaced. Contact the local Public Water System regarding jurisdiction to determine if the replacement of lead piping or service lines are under the jurisdiction of the District or other entity.

5.0 REPORTING AND RECORD KEEPING

In accordance with Subpart 67-4 the district shall:

1. Report the test results to the local health department as soon as practicable, but no more than 1 business day after the school received the laboratory report.
2. Notify all staff and all persons in parental relation to children or students of the test results, in writing, as soon as practicable, but no more than 10 business days after the school received the laboratory report.
3. The school shall make available, on the school’s website, the results of all lead testing performed and lead remediation plans implemented pursuant to Subpart 67-4, as soon as practicable, but no more than 6 weeks after the school received the laboratory reports.
4. As soon as practicable, but no more than 10 business days after the school received the laboratory reports, the school shall report data relating to test results to the NYS Health Department, local health department, and NYS Education Department, through the NYS Health Department’s designated statewide electronic reporting system.



5. The school shall retain all records of test results, lead remediation plans, and waiver requests, for ten years following the creation of such documentation. Copies of such documentation shall be immediately provided to the NYS Health Department, local health department, or NYS Education Department, upon request.



APPENDIX A:
DETAILED RESULTS SPREADSHEET

Willink Middle School				
Identification Code	Description	Date Sampled	Time Sampled	Result (µg/L)
WMS-01-RM-IN-C123-T	Teacher's Room C-123 Tap	9/24/2025	0550	<1.0
WMS-01-HA-BY-CAFÉ-DF	Drinking Fountain Outside of Cafetorium	9/24/2025	0552	<1.0
WMS-01-HA-BY-CAFÉ-BF	Bottle Filler Outside of Cafetorium	9/24/2025	0553	<1.0
WMS-01-RM-IN-KIT-CFT	Coffee Tap Line in Kitchen	9/24/2025	0555	<1.0
WMS-01-RM-IN-KIT-T1	Kitchen Left Sink Tap (On North Wall)	9/24/2025	0557	3.2
WMS-01-RM-IN-KIT-T2	Kitchen Middle Sink Tap (On North Wall)	9/24/2025	0558	<1.0
WMS-01-RM-IN-KIT-T5	Kitchen Right Hand Sprayer (On North Wall)	9/24/2025	0559	3.0
WMS-01-RM-IN-KIT-T3	Kitchen Northern Pot Filler	9/24/2025	0600	<1.0
WMS-01-HA-BY-KIT-DF	Drinking Fountain Outside of Kitchen	9/24/2025	0603	<1.0
WMS-01-CR-IN-G113-T	Room G113 Tap	9/24/2025	0608	<1.0
WMS-01-RM-BY-MLR-IM	Ice Machine Near Male Phys Ed Teacher Locker Room	9/24/2025	0610	<1.0
WMS-01-EXT-BY-EAST-T1	Sports Water Tree Spout 1	9/24/2025	0611	<1.0
WMS-01-EXT-BY-EAST-T2	Sports Water Tree Spout 2	9/24/2025	0612	<1.0
WMS-01-EXT-BY-EAST-T3	Sports Water Tree Spout 3	9/24/2025	0613	<1.0
WMS-01-EXT-BY-EAST-T4	Sports Water Tree Spout 4	9/24/2025	0614	<1.0
WMS-01-HA-BY-WR-DF	Drinking Fountain Near Weight Room	9/24/2025	0616	<1.0
WMS-01-HA-BY-WR-BF	Bottle Filler Near Weight Room	9/24/2025	0617	<1.0
WMS-01-RM-IN-E113-T	Makerspace E113 Tap	9/24/2025	0620	<1.0
WMS-01-CR-IN-E103-T1	Classroom E103 Left Tap (Facing Wall)	9/24/2025	0622	1.1
WMS-01-CR-IN-E103-T2	Classroom E103 Right Tap (Facing Wall)	9/24/2025	0623	<1.0
WMS-01-CR-IN-D106-T	Classroom D106 Tap	9/24/2025	0628	11.9
WMS-01-CR-IN-D106-B	Classroom D-106 Bubbler	9/24/2025	0629	1.0
WMS-01-RM-IN-MO-T2	Main Office Tap	9/24/2025	0631	<1.0
WMS-01-HA-BY-A111-DF	Drinking Fountain Near Classroom A111	9/24/2025	0635	<1.0
WMS-01-RM-IN-A116-T	Nurse's Main Office Tap	9/24/2025	0636	<1.0
WMS-01-HA-BY-A111-BF	Bottle Filler Near Classroom A111	9/24/2025	0636	<1.0
WMS-01-OFC-IN-A116-T	Nurse's Personal Office Tap	9/24/2025	0637	<1.0
WMS-01-HA-BY-LIB-DF	Drinking Fountain Near Library (North of Library)	9/24/2025	0640	<1.0
WMS-01-HA-BY-LIB-BF	Bottle Filler Near Library (North of Library)	9/24/2025	0641	<1.0
WMS-01-RM-BY-B123-T	Guidance Counselor Office B-123 Tap	9/24/2025	0643	<1.0
WMS-01-HA-BY-B111-DF	Drinking Fountain Near Classroom B111	9/24/2025	0646	<1.0
WMS-01-HA-BY-B111-BF	Bottle Filler Near Classroom B111	9/24/2025	0647	<1.0
WMS-01-CR-IN-C112-T	Tap In Classroom C112	9/24/2025	0650	<1.0

Willink Middle School				
Identification Code	Description	Date Sampled	Time Sampled	Result (µg/L)
WMS-01-CR-IN-C107-T	Tap In Classroom C107	9/24/2025	0651	<1.0
WMS-01-HA-BY-C111-DF	Drinking Fountain Near Classroom C111	9/24/2025	0652	<1.0
WMS-01-HA-BY-C111-BF	Bottle Filler Near Classroom C111	9/24/2025	0653	<1.0
WMS-02-HA-BY-C207-DF	Drinking Fountain Near Classroom C207	9/24/2025	0659	<1.0
WMS-02-HA-BY-C207-BF	Bottle Filler Near Classroom C207	9/24/2025	0700	<1.0
WMS-02-HA-BY-B207-DF	Drinking Fountain Near Classroom B207	9/24/2025	0706	<1.0
WMS-02-HA-BY-B207-BF	Bottle Filler Near Classroom B207	9/24/2025	0705	<1.0
WMS-02-HA-BY-A207-DF	Drinking Fountain Near Classroom A207	9/24/2025	0710	<1.0
WMS-02-HA-BY-A207-BF	Bottle Filler Near Classroom A207	9/24/2025	0711	<1.0



APPENDIX B:
LABORATORY ANALYTICAL
REPORTS



October 06, 2025

Service Request No:R2512078

Cory Stamp
Labella Associates, PC
300 State Street, 2nd Floor
Suite 201
Rochester, NY 14614

Laboratory Results for: Webster CSD-Willink

Dear Cory,

Enclosed are the results of the sample(s) submitted to our laboratory September 24, 2025
For your reference, these analyses have been assigned our service request number **R2512078**.

All testing was performed according to our laboratory's quality assurance program and met the requirements of the TNI standards except as noted in the case narrative report. Any testing not included in the lab's accreditation is identified on a Non-Certified Analytes report. All results are intended to be considered in their entirety. ALS Environmental is not responsible for use of less than the complete report. Results apply only to the individual samples submitted to the lab for analysis, as listed in the report. The measurement uncertainty of the results included in this report is within that expected when using the prescribed method(s), and represented by Laboratory Control Sample control limits. Any events, such as QC failures or Holding Time exceedances, which may add to the uncertainty are explained in the report narrative or are flagged with qualifiers. The flags are explained in the Report Qualifiers and Definitions page of this report.

Please contact me if you have any questions. My extension is 7475. You may also contact me via email at Meghan.Pedro@alsglobal.com.

Respectfully submitted,

ALS Group USA, Corp. dba ALS Environmental

Meghan Pedro
Project Manager

ADDRESS 1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
PHONE +1 585 288 5380 | **FAX** +1 585 288 8475
ALS Group USA, Corp.
dba ALS Environmental



Narrative Documents

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com



Client: Labella Associates, PC
Project: Webster CSD-Willink
Sample Matrix: Drinking Water

Service Request: R2512078
Date Received: 09/24/2025

CASE NARRATIVE

All analyses were performed consistent with the quality assurance program of ALS Environmental. This report contains analytical results for samples for the Tier II level requested by the client.

Sample Receipt:

Thirty two drinking water samples were received for analysis at ALS Environmental on 09/24/2025. Any discrepancies upon initial sample inspection are annotated on the sample receipt and preservation form included within this report. The samples were stored at minimum in accordance with the analytical method requirements.

Metals:

No significant anomalies were noted with this analysis.

A handwritten signature in black ink that reads "Meghan Pedro".

Approved by _____

Date 10/06/2025



SAMPLE DETECTION SUMMARY

This form includes only detections above the reporting levels. For a full listing of sample results, continue to the Sample Results section of this Report.

CLIENT ID: WMS-01-RM-IN-KIT-T1	Lab ID: R2512078-005					
---------------------------------------	-----------------------------	--	--	--	--	--

Analyte	Results	Flag	MDL	MRL	Units	Method
Lead, Total	3.2			1.0	ug/L	200.8

CLIENT ID: WMS-01-RM-IN-KIT-T3	Lab ID: R2512078-008					
---------------------------------------	-----------------------------	--	--	--	--	--

Analyte	Results	Flag	MDL	MRL	Units	Method
Lead, Total	3.0			1.0	ug/L	200.8

CLIENT ID: WMS-01-CR-IN-E103-T1	Lab ID: R2512078-019					
--	-----------------------------	--	--	--	--	--

Analyte	Results	Flag	MDL	MRL	Units	Method
Lead, Total	1.1			1.0	ug/L	200.8

CLIENT ID: WMS-01-CR-IN-D106-B	Lab ID: R2512078-022					
---------------------------------------	-----------------------------	--	--	--	--	--

Analyte	Results	Flag	MDL	MRL	Units	Method
Lead, Total	1.0			1.0	ug/L	200.8



Sample Receipt Information

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107

Service Request:R2512078

SAMPLE CROSS-REFERENCE

<u>SAMPLE #</u>	<u>CLIENT SAMPLE ID</u>	<u>DATE</u>	<u>TIME</u>
R2512078-001	WMS-01-RM-IN-C123-T	9/24/2025	0550
R2512078-002	WMS-01-HA-BY-CAFE-DF	9/24/2025	0552
R2512078-003	WMS-01-HA-BY-CAFE-BF	9/24/2025	0553
R2512078-004	WMS-01-RM-IN-KIT-CFT	9/24/2025	0555
R2512078-005	WMS-01-RM-IN-KIT-T1	9/24/2025	0557
R2512078-006	WMS-01-RM-IN-KIT-T2	9/24/2025	0558
R2512078-007	WMS-01-RM-IN-KIT-T5	9/24/2025	0559
R2512078-008	WMS-01-RM-IN-KIT-T3	9/24/2025	0600
R2512078-009	WMS-01-HA-BY-KIT-DF	9/24/2025	0603
R2512078-010	WMS-01-CR-IN-G113-T	9/24/2025	0608
R2512078-011	WMS-01-RM-BY-MLR-IM	9/24/2025	0610
R2512078-012	WMS-01-EXT-BY-EAST-T1	9/24/2025	0611
R2512078-013	WMS-01-EXT-BY-EAST-T2	9/24/2025	0612
R2512078-014	WMS-01-EXT-BY-EAST-T3	9/24/2025	0613
R2512078-015	WMS-01-EXT-BY-EAST-T4	9/24/2025	0614
R2512078-016	WMS-01-HA-BY-WR-DF	9/24/2025	0616
R2512078-017	WMS-01-HA-BY-WR-BF	9/24/2025	0617
R2512078-018	WMS-01-RM-IN-E113-T	9/24/2025	0620
R2512078-019	WMS-01-CR-IN-E103-T1	9/24/2025	0622
R2512078-020	WMS-01-CR-IN-E103-T2	9/24/2025	0623
R2512078-022	WMS-01-CR-IN-D106-B	9/24/2025	0629
R2512078-023	WMS-01-RM-IN-MO-T2	9/24/2025	0631
R2512078-024	WMS-01-HA-BY-A111-DF	9/24/2025	0635
R2512078-025	WMS-01-RM-IN-A116-T	9/24/2025	0636
R2512078-026	WMS-01-HA-BY-A111-BF	9/24/2025	0636
R2512078-027	WMS-01-OFC-IN-A116-T	9/24/2025	0637
R2512078-028	WMS-01-HA-BY-LIB-DF	9/24/2025	0640
R2512078-029	WMS-01-HA-BY-LIB-BF	9/24/2025	0641
R2512078-030	WMS-01-RM-BY-B123-T	9/24/2025	0643
R2512078-031	WMS-01-HA-BY-B111-DF	9/24/2025	0646
R2512078-032	WMS-01-HA-BY-B111-DF	9/24/2025	0647



ALS Environmental

Laboratory location:
Rochester NY

Chain of Custody Form

Page 1 of 3

Customer Information		Project Information					Parameter/Method Request for Analysis										
Purchase Order		Project Name	Webster CSD - <i>Willink</i>			A	EPA 200.8 Lead in Drinking Water										
Work Order		Project Number	2251107			B											
Company Name	LaBella Associates	Bill To Company	LaBella Associates			C											
Send Report To	<i>Cory Stamp</i>	Invoice Attn	<i>Cory Stamp</i>			D											
Address	300 State Street, Suite 200	Address	300 State Street, Suite 200			E											
						F											
City/State/Zip	Rochester, NY 14614	City/State/Zip	Rochester, NY 14614			G											
Phone	(607) 591-7516	Phone	(607) 591-7516			H											
Fax		Fax				I											
e-Mail Address	<i>cstamp@labellapc.com</i>	e-Mail Address	<i>cstamp@labellapc.com</i>			J											
No.	Sample Description	Date	Time	Matrix	Pres	# Bottles	A	B	C	D	E	F	G	H	I	J	Hold
1	See attached spreadsheets for sample descriptions. All samples are 250 mL plastic bottles, drinking water, with no preservative				N/A		X										
2					N/A		X										
3						N/A		X									
4																	
5																	
6																	
7																	
8																	
9																	
10																	

Sampler(s): Please Print & Sign *Cory Stamp*

Shipment Method: Delivered STD 10 Wk Days 5 Wk Days 2 Wk Days 24 Hour Other

Required Turnaround Time: Other

Results Due Date:

Relinquished by:	Date: 9/24/25	Time: 11:30	Received by: <i>William</i>	Date: 9/24/25	Time: 11:30	Notes:	
Relinquished by:	Date:	Time:	Received by (Laboratory):	Date:	Time:	Cooler Temp.:	
Logged by (Laboratory):	Date:	Time:	Checked by (Laboratory):	Date:	Time:	QC Package: (Check Box Below)	
Preservative Key: 1-HCL 2-HNO3 3-H2SO4 4-NaOH 5-Na2S2O3 6-NaHSO4 7-Other 8-4 degrees C 9-5035						Level II: Standard QC	TRRP-Checklist
						Level III: Std QC + Raw Data	TRRP Level IV
						Level IV: SW846 CLP-Like	
Other:						R2512078	5

Note: Any changes must be made in writing once samples and COC Form have been submitted to ALS Laboratory Group.
Signature denotes acceptance of ALS Group USA, Corp. Terms and Conditions - Please click the link below for detailed Terms & Conditions:
<https://www.alsglobal.com/ALSGroupUSACorpTC>
ALS copyright © 2024. All rights reserved.

Labella Associates, PC
Webster CSD-Willink

Willink Middle School			
Identification Code	Description	Date Sampled	Time Sampled
WMS-01-RM-IN-C123-T	Teacher's Room C-123 Tap	9/24/2025	0550
WMS-01-HA-BY-CAFÉ-DF	Drinking Fountain Outside of Cafetorium	9/24/2025	0552
WMS-01-HA-BY-CAFÉ-BF	Bottle Filler Outside of Cafetorium	9/24/2025	0553
WMS-01-RM-IN-KIT-CFT	Coffee Tap Line in Kitchen	9/24/2025	0555
WMS-01-RM-IN-KIT-T1	Kitchen Left Sink Tap (On North Wall)	9/24/2025	0557
WMS-01-RM-IN-KIT-T2	Kitchen Middle Sink Tap (On North Wall)	9/24/2025	0558
WMS-01-RM-IN-KIT-T5	Kitchen Right Hand Sprayer (On North Wall)	9/24/2025	0559
WMS-01-RM-IN-KIT-T3	Kitchen Northern Pot Filler	9/24/2025	0600
WMS-01-HA-BY-KIT-DF	Drinking Fountain Outside of Kitchen	9/24/2025	0603
WMS-01-CR-IN-G113-T	Room G113 Tap	9/24/2025	0608
WMS-01-RM-BY-MLR-IM	Ice Machine Near Male Phys Ed Teacher Locker Room	9/24/2025	0610
WMS-01-EXT-BY-EAST-T1	Sports Water Tree Spout 1	9/24/2025	0611
WMS-01-EXT-BY-EAST-T2	Sports Water Tree Spout 2	9/24/2025	0612
WMS-01-EXT-BY-EAST-T3	Sports Water Tree Spout 3	9/24/2025	0613
WMS-01-EXT-BY-EAST-T4	Sports Water Tree Spout 4	9/24/2025	0614
WMS-01-HA-BY-WR-DF	Drinking Fountain Near Weight Room	9/24/2025	0616
WMS-01-HA-BY-WR-BF	Bottle Filler Near Weight Room	9/24/2025	0617
WMS-01-RM-IN-E113-T	Makerspace E113 Tap	9/24/2025	0620
WMS-01-CR-IN-E103-T1	Classroom E103 Left Tap (Facing Wall)	9/24/2025	0622
WMS-01-CR-IN-E103-T2	Classroom E103 Right Tap (Facing Wall)	9/24/2025	0623
WMS-01-CR-IN-D103-T	Classroom D103 Tap	9/24/2025	0628
WMS-01-CR-IN-D106-B	Classroom D-106 Bubblers	9/24/2025	0629
WMS-01-RM-IN-MO-T2	Main Office Tap	9/24/2025	0631
WMS-01-HA-BY-A111-DF	Drinking Fountain Near Classroom A111	9/24/2025	0635
WMS-01-RM-IN-A116-T	Nurse's Main Office Tap	9/24/2025	0636
WMS-01-HA-BY-A111-BF	Bottle Filler Near Classroom A111	9/24/2025	0636
WMS-01-OFC-IN-A116-T	Nurse's Personal Office Tap	9/24/2025	0637
WMS-01-HA-BY-LIB-DF	Drinking Fountain Near Library (North of Library)	9/24/2025	0640
WMS-01-HA-BY-LIB-BF	Bottle Filler Near Library (North of Library)	9/24/2025	0641
WMS-01-RM-BY-B123-T	Guidance Counselor Office B-123 Tap	9/24/2025	0643
WMS-01-HA-BY-B111-DF	Drinking Fountain Near Classroom B111	9/24/2025	0646
WMS-01-HA-BY-B111-BF	Bottle Filler Near Classroom B111	9/24/2025	0647

R2512078

Labella Associates, PC
Webster CSD-Willink






R2512078

5

Labella Associates, PC
Webster CSD-Willink



Cooler Receipt and Preservation Check

Project/Client Labella Associates Folder Number _____

Cooler received on 9/24/25 by: RM

COURIER: ALS UPS FEDEX VELOCITY CLIENT

1	Were Custody seals on outside of cooler?	Y <u>(N)</u>	5a	Did VOA vials have sig* bubbles?	Y N <u>(NA)</u>
2	Custody papers properly completed (ink, signed)?	<u>(Y)</u> N	5b	Sig* bubbles: Alk? Y N <u>(NA)</u> Sulfide? Y N <u>(NA)</u>	
3	Did all bottles arrive in good condition (unbroken)?	<u>(Y)</u> N	6	Where did the bottles originate?	<u>ALS/ROC</u> CLIENT
4	Circle: Wet Ice Dry Ice Gel packs present?	Y <u>(N)</u>	7	Soil VOA received as: Bulk Encore 5035set	<u>(NA)</u>

8. Temperature Readings Date: 9/24/25 Time: 11:33 ID: IR#12 (IR#11) From: Temp Blank Sample Bottle

Temp (°C)	<u>21.6</u>						
Within 0-6°C?	Y N	Y N	Y N	Y N	Y N	Y N	Y N
If <0°C, were samples frozen?	Y N	Y N	Y N	Y N	Y N	Y N	Y N

If out of Temperature, note packing/ice condition: _____ Ice melted Poorly Packed (described below) Same Day Rule
& Client Approval to Run Samples: _____ Standing Approval Client aware at drop-off Client notified by: _____

All samples held in storage location: SMO by RM on 9/24 at 11:33
5035 samples placed in storage location: _____ by _____ on _____ at _____ within 48 hours of sampling? Y N

Cooler Breakdown/Preservation Check**: Date: 9/24 Time: 1543 by: AG

- 9. Were all bottle labels complete (i.e. analysis, preservation, etc.)? (YES) NO
- 10. Did all bottle labels and tags agree with custody papers? (YES) NO
- 11. Were correct containers used for the tests indicated? (YES) NO
- 12. Were 5035 vials acceptable (no extra labels, not leaking)? YES NO (N/A)
- 13. Were dissolved metals filtered in the field? YES NO (N/A)
- 14. Air Samples: Cassettes / Tubes Intact Y / N with MS Y / N Canisters Pressurized Tedlar® Bags Inflated (N/A)

pH	Lot of test paper	Reagent	Preserved?		Lot Received	Exp	Sample ID Adjusted	Vol. Added	Lot Added	Final pH
			Yes	No						
≥12		NaOH								
<2	<u>202324</u>	HNO ₃		<u>X</u>			<u>All</u>	<u>4mL</u>	<u>242357</u>	<u>≈2</u>
<2		H ₂ SO ₄								
<4		NaHSO ₄								
5-9		For 608pest			No=Notify for 3day					
Residual Chlorine (-)		For CN, Phenol, 625, 608pest, 522			If +, contact PM to add Na ₂ S ₂ O ₃ (625, 608, CN), ascorbic (phenol).					
		Na ₂ S ₂ O ₃								
		ZnAcetate	-	-						
		HCl	**	**						

**VOAs and 1664 Not to be tested before analysis. Otherwise, all bottles of all samples with chemical preservatives are checked (not just representatives).

Bottle lot numbers: 051025-2200
Explain all Discrepancies/ Other Comments:

HPROD	BULK
HTR	FLDT
SUB	HGFB
ALS	LL3541

Labels secondary reviewed by: AG *significant air bubbles: VOA > 5-6 mm : WC > 1 in. diameter



Miscellaneous Forms

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com



REPORT QUALIFIERS AND DEFINITIONS

- | | |
|---|--|
| <p>U Analyte was analyzed for but not detected. The sample quantitation limit has been corrected for dilution and for percent moisture, unless otherwise noted in the case narrative.</p> <p>J Estimated value due to either being a Tentatively Identified Compound (TIC) or that the concentration is between the MRL and the MDL. Concentrations are not verified within the linear range of the calibration. For DoD: concentration >40% difference between two GC columns (pesticides/Aroclors).</p> <p>B Analyte was also detected in the associated method blank at a concentration that may have contributed to the sample result.</p> <p>E Inorganics- Concentration is estimated due to the serial dilution was outside control limits.</p> <p>E Organics- Concentration has exceeded the calibration range for that specific analysis.</p> <p>D Concentration is a result of a dilution, typically a secondary analysis of the sample due to exceeding the calibration range or that a surrogate has been diluted out of the sample and cannot be assessed.</p> <p>* Indicates that a quality control parameter has exceeded laboratory limits. Under the “Notes” column of the Form I, this qualifier denotes analysis was performed out of Holding Time.</p> <p>H Analysis was performed out of hold time for tests that have an “immediate” hold time criteria.</p> <p># Spike was diluted out.</p> | <p>+ Correlation coefficient for MSA is <0.995.</p> <p>N Inorganics- Matrix spike recovery was outside laboratory limits.</p> <p>N Organics- Presumptive evidence of a compound (reported as a TIC) based on the MS library search.</p> <p>S Concentration has been determined using Method of Standard Additions (MSA).</p> <p>W Post-Digestion Spike recovery is outside control limits and the sample absorbance is <50% of the spike absorbance.</p> <p>P Concentration >40% difference between the two GC columns.</p> <p>C Confirmed by GC/MS</p> <p>Q DoD reports: indicates a pesticide/Aroclor is not confirmed ($\geq 100\%$ Difference between two GC columns).</p> <p>X See Case Narrative for discussion.</p> <p>MRL Method Reporting Limit. Also known as:</p> <p>LOQ Limit of Quantitation (LOQ)
The lowest concentration at which the method analyte may be reliably quantified under the method conditions.</p> <p>MDL Method Detection Limit. A statistical value derived from a study designed to provide the lowest concentration that will be detected 99% of the time. Values between the MDL and MRL are estimated (see J qualifier).</p> <p>LOD Limit of Detection. A value at or above the MDL which has been verified to be detectable.</p> <p>ND Non-Detect. Analyte was not detected at the concentration listed. Same as U qualifier.</p> |
|---|--|

Rochester Lab ID # for State Accreditations¹



NELAP States
Florida ID # E87674
New Hampshire ID # 2941
New York ID # 10145
Pennsylvania ID# 68-786
Texas ID#T104704581
Virginia #460167

Non-NELAP States
Connecticut ID #PH0556
Delaware Approved
Maine ID #NY01587
North Carolina #36701
North Carolina #676
Rhode Island LAO00333

¹ Analyses were performed according to our laboratory’s NELAP-approved quality assurance program and any applicable state or agency requirements. The test results meet requirements of the current NELAP/TNI standards or state or agency requirements, where applicable, except as noted in the case narrative. Since not all analyte/method/matrix combinations are offered for state/NELAC accreditation, this report may contain results which are not accredited. For a specific list of accredited analytes, contact the laboratory. To verify NH accredited analytes, go to <https://www4.des.state.nh.us/CertifiedLabs/Certified-Method.aspx>.

ALS Laboratory Group

Acronyms

ASTM	American Society for Testing and Materials
A2LA	American Association for Laboratory Accreditation
CARB	California Air Resources Board
CAS Number	Chemical Abstract Service registry Number
CFC	Chlorofluorocarbon
CFU	Colony-Forming Unit
DEC	Department of Environmental Conservation
DEQ	Department of Environmental Quality
DHS	Department of Health Services
DOE	Department of Ecology
DOH	Department of Health
EPA	U. S. Environmental Protection Agency
ELAP	Environmental Laboratory Accreditation Program
GC	Gas Chromatography
GC/MS	Gas Chromatography/Mass Spectrometry
LUFT	Leaking Underground Fuel Tank
M	Modified
MCL	Maximum Contaminant Level is the highest permissible concentration of a substance allowed in drinking water as established by the USEPA.
MDL	Method Detection Limit
MPN	Most Probable Number
MRL	Method Reporting Limit
NA	Not Applicable
NC	Not Calculated
NCASI	National Council of the Paper Industry for Air and Stream Improvement
ND	Not Detected
NIOSH	National Institute for Occupational Safety and Health
PQL	Practical Quantitation Limit
RCRA	Resource Conservation and Recovery Act
SIM	Selected Ion Monitoring
TPH	Total Petroleum Hydrocarbons
tr	Trace level is the concentration of an analyte that is less than the PQL but greater than or equal to the MDL.

ALS Group USA, Corp.
dba ALS Environmental

Analyst Summary report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107

Service Request: R2512078

Sample Name: WMS-01-RM-IN-C123-T
Lab Code: R2512078-001
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-HA-BY-CAFE-DF
Lab Code: R2512078-002
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-HA-BY-CAFE-BF
Lab Code: R2512078-003
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-RM-IN-KIT-CFT
Lab Code: R2512078-004
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-RM-IN-KIT-T1
Lab Code: R2512078-005
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

ALS Group USA, Corp.
dba ALS Environmental

Analyst Summary report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107

Service Request: R2512078

Sample Name: WMS-01-RM-IN-KIT-T2
Lab Code: R2512078-006
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-RM-IN-KIT-T5
Lab Code: R2512078-007
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-RM-IN-KIT-T3
Lab Code: R2512078-008
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-HA-BY-KIT-DF
Lab Code: R2512078-009
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-CR-IN-G113-T
Lab Code: R2512078-010
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

ALS Group USA, Corp.
dba ALS Environmental

Analyst Summary report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107

Service Request: R2512078

Sample Name: WMS-01-RM-BY-MLR-IM
Lab Code: R2512078-011
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-EXT-BY-EAST-T1
Lab Code: R2512078-012
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-EXT-BY-EAST-T2
Lab Code: R2512078-013
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-EXT-BY-EAST-T3
Lab Code: R2512078-014
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-EXT-BY-EAST-T4
Lab Code: R2512078-015
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

ALS Group USA, Corp.
dba ALS Environmental

Analyst Summary report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107

Service Request: R2512078

Sample Name: WMS-01-HA-BY-WR-DF
Lab Code: R2512078-016
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-HA-BY-WR-BF
Lab Code: R2512078-017
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-RM-IN-E113-T
Lab Code: R2512078-018
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-CR-IN-E103-T1
Lab Code: R2512078-019
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-CR-IN-E103-T2
Lab Code: R2512078-020
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

ALS Group USA, Corp.
dba ALS Environmental

Analyst Summary report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107

Service Request: R2512078

Sample Name: WMS-01-CR-IN-D106-B
Lab Code: R2512078-022
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-RM-IN-MO-T2
Lab Code: R2512078-023
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-HA-BY-A111-DF
Lab Code: R2512078-024
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-RM-IN-A116-T
Lab Code: R2512078-025
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-HA-BY-A111-BF
Lab Code: R2512078-026
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

ALS Group USA, Corp.
dba ALS Environmental

Analyst Summary report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107

Service Request: R2512078

Sample Name: WMS-01-OFC-IN-A116-T
Lab Code: R2512078-027
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-HA-BY-LIB-DF
Lab Code: R2512078-028
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-HA-BY-LIB-BF
Lab Code: R2512078-029
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-RM-BY-B123-T
Lab Code: R2512078-030
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

Sample Name: WMS-01-HA-BY-B111-DF
Lab Code: R2512078-031
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN

ALS Group USA, Corp.
dba ALS Environmental

Analyst Summary report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107

Service Request: R2512078

Sample Name: WMS-01-HA-BY-B111-DF
Lab Code: R2512078-032
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
MKASTAN



Sample Results

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com



Metals

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-RM-IN-C123-T
Lab Code: R2512078-001

Service Request: R2512078
Date Collected: 09/24/25 05:50
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 19:36	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-HA-BY-CAFE-DF
Lab Code: R2512078-002

Service Request: R2512078
Date Collected: 09/24/25 05:52
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 19:37	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-HA-BY-CAFE-BF
Lab Code: R2512078-003

Service Request: R2512078
Date Collected: 09/24/25 05:53
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 19:39	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-RM-IN-KIT-CFT
Lab Code: R2512078-004

Service Request: R2512078
Date Collected: 09/24/25 05:55
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 19:43	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-RM-IN-KIT-T1
Lab Code: R2512078-005

Service Request: R2512078
Date Collected: 09/24/25 05:57
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	3.2	ug/L	1.0	1	10/01/25 19:45	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-RM-IN-KIT-T2
Lab Code: R2512078-006

Service Request: R2512078
Date Collected: 09/24/25 05:58
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 19:46	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-RM-IN-KIT-T5
Lab Code: R2512078-007

Service Request: R2512078
Date Collected: 09/24/25 05:59
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 19:48	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-RM-IN-KIT-T3
Lab Code: R2512078-008

Service Request: R2512078
Date Collected: 09/24/25 06:00
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	3.0	ug/L	1.0	1	10/01/25 19:49	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-HA-BY-KIT-DF
Lab Code: R2512078-009

Service Request: R2512078
Date Collected: 09/24/25 06:03
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 19:51	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-CR-IN-G113-T
Lab Code: R2512078-010

Service Request: R2512078
Date Collected: 09/24/25 06:08
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 19:53	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-RM-BY-MLR-IM
Lab Code: R2512078-011

Service Request: R2512078
Date Collected: 09/24/25 06:10
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 19:54	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-EXT-BY-EAST-T1
Lab Code: R2512078-012

Service Request: R2512078
Date Collected: 09/24/25 06:11
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 19:56	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-EXT-BY-EAST-T2
Lab Code: R2512078-013

Service Request: R2512078
Date Collected: 09/24/25 06:12
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 19:57	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-EXT-BY-EAST-T3
Lab Code: R2512078-014

Service Request: R2512078
Date Collected: 09/24/25 06:13
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 20:02	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-EXT-BY-EAST-T4
Lab Code: R2512078-015

Service Request: R2512078
Date Collected: 09/24/25 06:14
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 20:03	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-HA-BY-WR-DF
Lab Code: R2512078-016

Service Request: R2512078
Date Collected: 09/24/25 06:16
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 20:05	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-HA-BY-WR-BF
Lab Code: R2512078-017

Service Request: R2512078
Date Collected: 09/24/25 06:17
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 20:06	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-RM-IN-E113-T
Lab Code: R2512078-018

Service Request: R2512078
Date Collected: 09/24/25 06:20
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 20:17	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-CR-IN-E103-T1
Lab Code: R2512078-019

Service Request: R2512078
Date Collected: 09/24/25 06:22
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.1	ug/L	1.0	1	10/01/25 20:22	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-CR-IN-E103-T2
Lab Code: R2512078-020

Service Request: R2512078
Date Collected: 09/24/25 06:23
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 20:23	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-CR-IN-D106-B
Lab Code: R2512078-022

Service Request: R2512078
Date Collected: 09/24/25 06:29
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0	ug/L	1.0	1	10/01/25 20:25	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-RM-IN-MO-T2
Lab Code: R2512078-023

Service Request: R2512078
Date Collected: 09/24/25 06:31
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 20:26	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-HA-BY-A111-DF
Lab Code: R2512078-024

Service Request: R2512078
Date Collected: 09/24/25 06:35
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 20:28	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-RM-IN-A116-T
Lab Code: R2512078-025

Service Request: R2512078
Date Collected: 09/24/25 06:36
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 20:32	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-HA-BY-A111-BF
Lab Code: R2512078-026

Service Request: R2512078
Date Collected: 09/24/25 06:36
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 20:34	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-OFC-IN-A116-T
Lab Code: R2512078-027

Service Request: R2512078
Date Collected: 09/24/25 06:37
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 20:36	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-HA-BY-LIB-DF
Lab Code: R2512078-028

Service Request: R2512078
Date Collected: 09/24/25 06:40
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 20:37	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-HA-BY-LIB-BF
Lab Code: R2512078-029

Service Request: R2512078
Date Collected: 09/24/25 06:41
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 20:39	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-RM-BY-B123-T
Lab Code: R2512078-030

Service Request: R2512078
Date Collected: 09/24/25 06:43
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 20:40	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-HA-BY-B111-DF
Lab Code: R2512078-031

Service Request: R2512078
Date Collected: 09/24/25 06:46
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 20:42	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: WMS-01-HA-BY-B111-DF
Lab Code: R2512078-032

Service Request: R2512078
Date Collected: 09/24/25 06:47
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 20:43	



QC Summary Forms

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com



Metals

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: Method Blank
Lab Code: R2512078-MB1

Service Request: R2512078
Date Collected: NA
Date Received: NA
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 19:25	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water
Sample Name: Method Blank
Lab Code: R2512078-MB2

Service Request: R2512078
Date Collected: NA
Date Received: NA
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/01/25 20:14	

ALS Group USA, Corp.
dba ALS Environmental

QA/QC Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water

Service Request: R2512078
Date Collected: 09/24/25
Date Received: 09/24/25
Date Analyzed: 10/1/25

**Duplicate Matrix Spike Summary
Inorganic Parameters**

Sample Name: WMS-01-HA-BY-WR-BF
Lab Code: R2512078-017
Analysis Method: 200.8

Units: ug/L
Basis: NA

Analyte Name	Sample Result	Result	Matrix Spike R2512078-017MS		Duplicate Matrix Spike R2512078-017DMS		% Rec Limits	RPD	RPD Limit	
			Spike Amount	% Rec	Result	Spike Amount				% Rec
Lead, Total	1.0 U	18.9	20.0	94	18.7	20.0	94	70-130	<1	20

Results flagged with an asterisk (*) indicate values outside control criteria.

Results flagged with a pound (#) indicate the control criteria is not applicable.

Percent recoveries and relative percent differences (RPD) are determined by the software using values in the calculation which have not been rounded.

Matrix Spike and Matrix Spike Duplicate Data is presented for information purposes only. The matrix may or may not be relevant to samples reported in this report. The laboratory evaluates system performance based on the LCS and LCSD control limits.

ALS Group USA, Corp.
dba ALS Environmental

QA/QC Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water

Service Request: R2512078
Date Collected: 09/24/25
Date Received: 09/24/25
Date Analyzed: 10/1/25

**Duplicate Matrix Spike Summary
Inorganic Parameters**

Sample Name: WMS-01-RM-IN-E113-T
Lab Code: R2512078-018
Analysis Method: 200.8

Units: ug/L
Basis: NA

Analyte Name	Sample Result	Result	Matrix Spike R2512078-018MS		Result	Duplicate Matrix Spike R2512078-018DMS		% Rec Limits	RPD	RPD Limit
			Spike Amount	% Rec		Spike Amount	% Rec			
Lead, Total	1.0 U	18.8	20.0	94	18.9	20.0	94	70-130	<1	20

Results flagged with an asterisk (*) indicate values outside control criteria.

Results flagged with a pound (#) indicate the control criteria is not applicable.

Percent recoveries and relative percent differences (RPD) are determined by the software using values in the calculation which have not been rounded.

Matrix Spike and Matrix Spike Duplicate Data is presented for information purposes only. The matrix may or may not be relevant to samples reported in this report. The laboratory evaluates system performance based on the LCS and LCSD control limits.

ALS Group USA, Corp.

dba ALS Environmental

QA/QC Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water

Service Request: R2512078

Date Analyzed: 10/01/25

Lab Control Sample Summary
Inorganic Parameters

Units:ug/L

Basis:NA

Lab Control Sample

R2512078-LCS1

Analyte Name	Analytical Method	Result	Spike Amount	% Rec	% Rec Limits
Lead, Total	200.8	19.1	20.0	95	85-115

ALS Group USA, Corp.
dba ALS Environmental

QA/QC Report

Client: Labella Associates, PC
Project: Webster CSD-Willink/2251107
Sample Matrix: Drinking Water

Service Request: R2512078
Date Analyzed: 10/01/25

Lab Control Sample Summary
Inorganic Parameters

Units:ug/L
Basis:NA

Lab Control Sample
R2512078-LCS2

Analyte Name	Analytical Method	Result	Spike Amount	% Rec	% Rec Limits
Lead, Total	200.8	18.7	20.0	93	85-115



October 21, 2025

Service Request No:R2512693

Cory Stamp
Labella Associates, PC
300 State Street, 2nd Floor
Suite 201
Rochester, NY 14614

Laboratory Results for: Willink Middle School

Dear Cory,

Enclosed are the results of the sample(s) submitted to our laboratory September 24, 2025
For your reference, these analyses have been assigned our service request number **R2512693**.

All testing was performed according to our laboratory's quality assurance program and met the requirements of the TNI standards except as noted in the case narrative report. Any testing not included in the lab's accreditation is identified on a Non-Certified Analytes report. All results are intended to be considered in their entirety. ALS Environmental is not responsible for use of less than the complete report. Results apply only to the individual samples submitted to the lab for analysis, as listed in the report. The measurement uncertainty of the results included in this report is within that expected when using the prescribed method(s), and represented by Laboratory Control Sample control limits. Any events, such as QC failures or Holding Time exceedances, which may add to the uncertainty are explained in the report narrative or are flagged with qualifiers. The flags are explained in the Report Qualifiers and Definitions page of this report.

Please contact me if you have any questions. My extension is 7475. You may also contact me via email at Meghan.Pedro@alsglobal.com.

Respectfully submitted,

ALS Group USA, Corp. dba ALS Environmental

Meghan Pedro
Project Manager

ADDRESS 1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
PHONE +1 585 288 5380 | **FAX** +1 585 288 8475
ALS Group USA, Corp.
dba ALS Environmental



Narrative Documents

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com



Client: Labella Associates, PC
Project: Willink Middle School
Sample Matrix: Drinking Water

Service Request: R2512693
Date Received: 09/24/2025

CASE NARRATIVE

All analyses were performed consistent with the quality assurance program of ALS Environmental. This report contains analytical results for samples for the Tier II level requested by the client.

Sample Receipt:

Eleven drinking water samples were received for analysis at ALS Environmental on 09/24/2025. Any discrepancies upon initial sample inspection are annotated on the sample receipt and preservation form included within this report. The samples were stored at minimum in accordance with the analytical method requirements.

Metals:

No significant anomalies were noted with this analysis.

A handwritten signature in black ink that reads "Meghan Pedro".

Approved by _____

Date 10/21/2025



SAMPLE DETECTION SUMMARY

This form includes only detections above the reporting levels. For a full listing of sample results, continue to the Sample Results section of this Report.

CLIENT ID: WMS-01-CR-IN-C112-T			Lab ID: R2512693-001			
---------------------------------------	--	--	-----------------------------	--	--	--

Analyte	Results	Flag	MDL	MRL	Units	Method
Lead, Total	1.2			1.0	ug/L	200.8

CLIENT ID: WMS-01-CR-IN-C107-T			Lab ID: R2512693-002			
---------------------------------------	--	--	-----------------------------	--	--	--

Analyte	Results	Flag	MDL	MRL	Units	Method
Lead, Total	1.6			1.0	ug/L	200.8

CLIENT ID: WMS-01-CR-IN-D106-T			Lab ID: R2512693-011			
---------------------------------------	--	--	-----------------------------	--	--	--

Analyte	Results	Flag	MDL	MRL	Units	Method
Lead, Total	11.9			1.0	ug/L	200.8



Sample Receipt Information

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com


Client: Labella Associates, PC
Project: Willink Middle School

Service Request:R2512693

SAMPLE CROSS-REFERENCE

<u>SAMPLE #</u>	<u>CLIENT SAMPLE ID</u>	<u>DATE</u>	<u>TIME</u>
R2512693-001	WMS-01-CR-IN-C112-T	9/24/2025	0650
R2512693-002	WMS-01-CR-IN-C107-T	9/24/2025	0651
R2512693-003	WMS-01-HA-BY-C111-DF	9/24/2025	0652
R2512693-004	WMS-01-HA-BY-C111-BF	9/24/2025	0653
R2512693-005	WMS-02-HA-BY-C207-DF	9/24/2025	0659
R2512693-006	WMS-02-HA-BY-C207-BF	9/24/2025	0700
R2512693-007	WMS-02-HA-BY-A207-DF	9/24/2025	0710
R2512693-008	WMS-02-HA-BY-A207-BF	9/24/2025	0711
R2512693-009	WMS-02-HA-BY-B207-BF	9/24/2025	0706
R2512693-010	WMS-02-HA-BY-B207-DF	9/24/2025	0705
R2512693-011	WMS-01-CR-IN-D106-T	9/24/2025	0628

Willink Middle School			
Identification Code	Description	Date Sampled	Time Sampled
WMS-01-CR-IN-C112-T	Tap In Classroom C112	9/24/2025	0650
WMS-01-CR-IN-C107-T	Tap In Classroom C107	9/24/2025	0651
WMS-01-HA-BY-C111-DF	Drinking Fountain Near Classroom C111	9/24/2025	0652
WMS-01-HA-BY-C111-BF	Bottle Filler Near Classroom C111	9/24/2025	0653
WMS-02-HA-BY-C207-DF	Drinking Fountain Near Classroom C207	9/24/2025	0659
WMS-02-HA-BY-C207-BF	Bottle Filler Near Classroom C207	9/24/2025	0700
WMS-02-HA-BY-A207-DF	Drinking Fountain Near Classroom A207	9/24/2025	0710
WMS-02-HA-BY-A207-BF	Bottle Filler Near Classroom A207	9/24/2025	0711

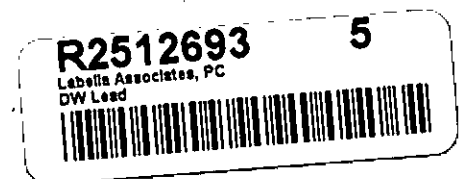



R2512693

5

Labella Associates, PC
DW Lead



Cooler Receipt and Preservation CI

Project/Client Labella Associates Folder Number _____

Cooler received on 9/24/25 by: RM

COURIER: ALS UPS FEDEX VELOCITY CLIENT

1	Were Custody seals on outside of cooler?	Y	N	5a	Did VOA vials have sig* bubbles?	Y	N	NA
2	Custody papers properly completed (ink, signed)?	Y	N	5b	Sig* bubbles: Alk?	Y	N	NA
3	Did all bottles arrive in good condition (unbroken)?	Y	N	6	Where did the bottles originate?	ALS/ROC	CLIENT	
4	Circle: Wet Ice Dry Ice Gel packs present?	Y	N	7	Soil VOA received as:	Bulk	Encore	5035set

8. Temperature Readings Date: 9/24/25 Time: 11:33 ID: IR#12 IR#1 From: Temp Blank Sample Bottle

Temp (°C)	<u>21.6</u>						
Within 0-6°C?	Y	N	Y	N	Y	N	Y
If <0°C, were samples frozen?	Y	N	Y	N	Y	N	Y

If out of Temperature, note packing/ice condition: _____ Ice melted Poorly Packed (described below) Same Day Rule
& Client Approval to Run Samples: _____ Standing Approval Client aware at drop-off Client notified by: _____

All samples held in storage location: SMD by RM on 9/24 at 11:33
5035 samples placed in storage location: _____ by _____ on _____ at _____ within 48 hours of sampling? Y N

Cooler Breakdown/Preservation Check**: Date: 9/24 Time: 1543 by: AG

- 9. Were all bottle labels complete (i.e. analysis, preservation, etc.)? YES NO
- 10. Did all bottle labels and tags agree with custody papers? YES NO
- 11. Were correct containers used for the tests indicated? YES NO
- 12. Were 5035 vials acceptable (no extra labels, not leaking)? YES NO N/A
- 13. Were dissolved metals filtered in the field? YES NO N/A
- 14. Air Samples: Cassettes / Tubes Intact Y / N with MS Y / N Canisters Pressurized Tedlar® Bags Inflated N/A

pH	Lot of test paper	Reagent	Preserved?		Lot Received	Exp	Sample ID Adjusted	Vol. Added	Lot Added	Final pH
			Yes	No						
≥12		NaOH								
≤2	<u>202324</u>	HNO ₃		X			<u>All</u>	<u>4mL</u>	<u>242357</u>	<u>±2</u>
≤2		H ₂ SO ₄								
<4		NaHSO ₄								
5-9		For 608pest			No-Notify for 3day					
Residual Chlorine (-)		For CN, Phenol, 625, 608pest, 522			If +, contact PM to add Na ₂ S ₂ O ₃ (625, 608, CN), ascorbic (phenol).					
		Na ₂ S ₂ O ₃								
		ZnAcetate	-	-						
		HCl	**	**						

**VOAs and 1664 Not to be tested before analysis. Otherwise, all bottles of all samples with chemical preservatives are checked (not just representatives).

Bottle lot numbers: 051025-2400
Explain all Discrepancies/ Other Comments:

HPROD	BULK
HTR	FLDT
SUB	HGFB
ALS	LL3541

Labels secondary reviewed by: AG *significant air bubbles: VOA > 5-6 mm : WC > 1 in. diameter



Miscellaneous Forms

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com



REPORT QUALIFIERS AND DEFINITIONS

- U Analyte was analyzed for but not detected. The sample quantitation limit has been corrected for dilution and for percent moisture, unless otherwise noted in the case narrative.
- J Estimated value due to either being a Tentatively Identified Compound (TIC) or that the concentration is between the MRL and the MDL. Concentrations are not verified within the linear range of the calibration. For DoD: concentration >40% difference between two GC columns (pesticides/Aroclors).
- B Analyte was also detected in the associated method blank at a concentration that may have contributed to the sample result.
- E Inorganics- Concentration is estimated due to the serial dilution was outside control limits.
- E Organics- Concentration has exceeded the calibration range for that specific analysis.
- D Concentration is a result of a dilution, typically a secondary analysis of the sample due to exceeding the calibration range or that a surrogate has been diluted out of the sample and cannot be assessed.
- * Indicates that a quality control parameter has exceeded laboratory limits. Under the "Notes" column of the Form I, this qualifier denotes analysis was performed out of Holding Time.
- H Analysis was performed out of hold time for tests that have an "immediate" hold time criteria.
- # Spike was diluted out.
- + Correlation coefficient for MSA is <0.995.
- N Inorganics- Matrix spike recovery was outside laboratory limits.
- N Organics- Presumptive evidence of a compound (reported as a TIC) based on the MS library search.
- S Concentration has been determined using Method of Standard Additions (MSA).
- W Post-Digestion Spike recovery is outside control limits and the sample absorbance is <50% of the spike absorbance.
- P Concentration >40% difference between the two GC columns.
- C Confirmed by GC/MS
- Q DoD reports: indicates a pesticide/Aroclor is not confirmed ($\geq 100\%$ Difference between two GC columns).
- X See Case Narrative for discussion.
- MRL Method Reporting Limit. Also known as:
- LOQ Limit of Quantitation (LOQ)
The lowest concentration at which the method analyte may be reliably quantified under the method conditions.
- MDL Method Detection Limit. A statistical value derived from a study designed to provide the lowest concentration that will be detected 99% of the time. Values between the MDL and MRL are estimated (see J qualifier).
- LOD Limit of Detection. A value at or above the MDL which has been verified to be detectable.
- ND Non-Detect. Analyte was not detected at the concentration listed. Same as U qualifier.

Rochester Lab ID # for State Accreditations¹



NELAP States
Florida ID # E87674
New Hampshire ID # 2941
New York ID # 10145
Pennsylvania ID# 68-786
Texas ID#T104704581
Virginia #460167

Non-NELAP States
Connecticut ID #PH0556
Delaware Approved
Maine ID #NY01587
North Carolina #36701
North Carolina #676
Rhode Island LAO00333

¹ Analyses were performed according to our laboratory's NELAP-approved quality assurance program and any applicable state or agency requirements. The test results meet requirements of the current NELAP/TNI standards or state or agency requirements, where applicable, except as noted in the case narrative. Since not all analyte/method/matrix combinations are offered for state/NELAC accreditation, this report may contain results which are not accredited. For a specific list of accredited analytes, contact the laboratory. To verify NH accredited analytes, go to <https://www4.des.state.nh.us/CertifiedLabs/Certified-Method.aspx>.

ALS Laboratory Group

Acronyms

ASTM	American Society for Testing and Materials
A2LA	American Association for Laboratory Accreditation
CARB	California Air Resources Board
CAS Number	Chemical Abstract Service registry Number
CFC	Chlorofluorocarbon
CFU	Colony-Forming Unit
DEC	Department of Environmental Conservation
DEQ	Department of Environmental Quality
DHS	Department of Health Services
DOE	Department of Ecology
DOH	Department of Health
EPA	U. S. Environmental Protection Agency
ELAP	Environmental Laboratory Accreditation Program
GC	Gas Chromatography
GC/MS	Gas Chromatography/Mass Spectrometry
LUFT	Leaking Underground Fuel Tank
M	Modified
MCL	Maximum Contaminant Level is the highest permissible concentration of a substance allowed in drinking water as established by the USEPA.
MDL	Method Detection Limit
MPN	Most Probable Number
MRL	Method Reporting Limit
NA	Not Applicable
NC	Not Calculated
NCASI	National Council of the Paper Industry for Air and Stream Improvement
ND	Not Detected
NIOSH	National Institute for Occupational Safety and Health
PQL	Practical Quantitation Limit
RCRA	Resource Conservation and Recovery Act
SIM	Selected Ion Monitoring
TPH	Total Petroleum Hydrocarbons
tr	Trace level is the concentration of an analyte that is less than the PQL but greater than or equal to the MDL.

ALS Group USA, Corp.
dba ALS Environmental

Analyst Summary report

Client: Labella Associates, PC
Project: Willink Middle School/

Service Request: R2512693

Sample Name: WMS-01-CR-IN-C112-T
Lab Code: R2512693-001
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
NMANSEN

Sample Name: WMS-01-CR-IN-C107-T
Lab Code: R2512693-002
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
NMANSEN

Sample Name: WMS-01-HA-BY-C111-DF
Lab Code: R2512693-003
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
NMANSEN

Sample Name: WMS-01-HA-BY-C111-BF
Lab Code: R2512693-004
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
NMANSEN

Sample Name: WMS-02-HA-BY-C207-DF
Lab Code: R2512693-005
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
NMANSEN

ALS Group USA, Corp.
dba ALS Environmental

Analyst Summary report

Client: Labella Associates, PC
Project: Willink Middle School/

Service Request: R2512693

Sample Name: WMS-02-HA-BY-C207-BF
Lab Code: R2512693-006
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
NMANSEN

Sample Name: WMS-02-HA-BY-A207-DF
Lab Code: R2512693-007
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
NMANSEN

Sample Name: WMS-02-HA-BY-A207-BF
Lab Code: R2512693-008
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
NMANSEN

Sample Name: WMS-02-HA-BY-B207-BF
Lab Code: R2512693-009
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
NMANSEN

Sample Name: WMS-02-HA-BY-B207-DF
Lab Code: R2512693-010
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
NMANSEN

ALS Group USA, Corp.
dba ALS Environmental

Analyst Summary report

Client: Labella Associates, PC
Project: Willink Middle School/

Service Request: R2512693

Sample Name: WMS-01-CR-IN-D106-T
Lab Code: R2512693-011
Sample Matrix: Drinking Water

Date Collected: 09/24/25
Date Received: 09/24/25

Analysis Method
200.8

Extracted/Digested By

Analyzed By
NMANSEN



Sample Results

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com



Metals

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Willink Middle School
Sample Matrix: Drinking Water
Sample Name: WMS-01-CR-IN-C112-T
Lab Code: R2512693-001

Service Request: R2512693
Date Collected: 09/24/25 06:50
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.2	ug/L	1.0	1	10/20/25 15:29	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Willink Middle School
Sample Matrix: Drinking Water
Sample Name: WMS-01-CR-IN-C107-T
Lab Code: R2512693-002

Service Request: R2512693
Date Collected: 09/24/25 06:51
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.6	ug/L	1.0	1	10/20/25 15:30	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Willink Middle School
Sample Matrix: Drinking Water
Sample Name: WMS-01-HA-BY-C111-DF
Lab Code: R2512693-003

Service Request: R2512693
Date Collected: 09/24/25 06:52
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/20/25 15:32	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Willink Middle School
Sample Matrix: Drinking Water
Sample Name: WMS-01-HA-BY-C111-BF
Lab Code: R2512693-004

Service Request: R2512693
Date Collected: 09/24/25 06:53
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/20/25 15:33	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Willink Middle School
Sample Matrix: Drinking Water
Sample Name: WMS-02-HA-BY-C207-DF
Lab Code: R2512693-005

Service Request: R2512693
Date Collected: 09/24/25 06:59
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/20/25 15:35	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Willink Middle School
Sample Matrix: Drinking Water
Sample Name: WMS-02-HA-BY-C207-BF
Lab Code: R2512693-006

Service Request: R2512693
Date Collected: 09/24/25 07:00
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/20/25 15:36	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Willink Middle School
Sample Matrix: Drinking Water
Sample Name: WMS-02-HA-BY-A207-DF
Lab Code: R2512693-007

Service Request: R2512693
Date Collected: 09/24/25 07:10
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/20/25 15:37	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Willink Middle School
Sample Matrix: Drinking Water
Sample Name: WMS-02-HA-BY-A207-BF
Lab Code: R2512693-008

Service Request: R2512693
Date Collected: 09/24/25 07:11
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/20/25 15:39	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Willink Middle School
Sample Matrix: Drinking Water
Sample Name: WMS-02-HA-BY-B207-BF
Lab Code: R2512693-009

Service Request: R2512693
Date Collected: 09/24/25 07:06
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/20/25 15:40	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Willink Middle School
Sample Matrix: Drinking Water
Sample Name: WMS-02-HA-BY-B207-DF
Lab Code: R2512693-010

Service Request: R2512693
Date Collected: 09/24/25 07:05
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/20/25 15:42	

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Willink Middle School
Sample Matrix: Drinking Water
Sample Name: WMS-01-CR-IN-D106-T
Lab Code: R2512693-011

Service Request: R2512693
Date Collected: 09/24/25 06:28
Date Received: 09/24/25 11:30
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	11.9	ug/L	1.0	1	10/20/25 15:46	



QC Summary Forms

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com



Metals

ALS Environmental—Rochester Laboratory
1565 Jefferson Road, Building 300, Suite 360, Rochester, NY 14623
Phone (585) 288-5380 Fax (585) 288-8475
www.alsglobal.com

ALS Group USA, Corp.
dba ALS Environmental

Analytical Report

Client: Labella Associates, PC
Project: Willink Middle School
Sample Matrix: Drinking Water
Sample Name: Method Blank
Lab Code: R2512693-MB

Service Request: R2512693
Date Collected: NA
Date Received: NA
Basis: NA

Inorganic Parameters

Analyte Name	Analysis Method	Result	Units	MRL	Dil.	Date Analyzed	Q
Lead, Total	200.8	1.0 U	ug/L	1.0	1	10/20/25 15:12	

ALS Group USA, Corp.
dba ALS Environmental

QA/QC Report

Client: Labella Associates, PC
Project: Willink Middle School
Sample Matrix: Drinking Water

Service Request: R2512693
Date Analyzed: 10/20/25

Lab Control Sample Summary
Inorganic Parameters

Units:ug/L
Basis:NA

Lab Control Sample
R2512693-LCS

Analyte Name	Analytical Method	Result	Spike Amount	% Rec	% Rec Limits
Lead, Total	200.8	19.6	20.0	98	85-115



APPENDIX C:
LICENSES AND CERTIFICATIONS

United States Environmental Protection Agency

This is to certify that

LaBella Associates, D.P.C.

has fulfilled the requirements of the Toxic Substances Control Act (TSCA) Section 402, and has received certification to conduct lead-based paint activities pursuant to 40 CFR Part 745.226

In the Jurisdiction of:

All EPA Administered Lead-based Paint Activities Program States, Tribes and Territories

This certification is valid from the date of issuance and expires September 26, 2027

LBP-2226-3

Certification #

August 01, 2024

Issued On



A handwritten signature in black ink, appearing to read "Marc Edmonds".

Marc Edmonds, Chief

Risk Assessment Management Branch 2.

United States Environmental Protection Agency

This is to certify that



Cory J Stamp

has fulfilled the requirements of the Toxic Substances Control Act (TSCA) Section 402, and has received certification to conduct lead-based paint activities pursuant to 40 CFR Part 745.226 as:

Risk Assessor

In the Jurisdiction of:

All EPA Administered Lead-based Paint Activities Program States, Tribes and Territories

This certification is valid from the date of issuance and expires October 24, 2028

LBP-R-I206349-3

Certification #

October 15, 2025

Issued On



A handwritten signature in black ink that reads "Ben Conetta".

Ben Conetta, Manager

Chemicals and Multimedia Programs Branch

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2026
Issued April 01, 2025

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MS. CHRISTINE KUTZER
ALS ENVIRONMENTAL - ROCHESTER
1565 JEFFERSON ROAD BUILDING 300, SUITE 360
ROCHESTER, NY 14623

NY Lab Id No: 10145

*is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2016) for the category
ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:*

Bacteriology

Coliform, Total / E. coli (Qualitative) SM 20, 21-23 9223B (-04) (Colilert)

Dissolved Gases

Acetylene RSK-175
Ethane RSK-175
Ethene (Ethylene) RSK-175
Methane RSK-175
Propane RSK-175

Fuel Additives

Methyl tert-butyl ether EPA 524.2
Naphthalene EPA 524.2

Metals I

Arsenic, Total EPA 200.8 Rev. 5.4
Barium, Total EPA 200.8 Rev. 5.4
Cadmium, Total EPA 200.8 Rev. 5.4
Chromium, Total EPA 200.7 Rev. 4.4
Copper, Total EPA 200.8 Rev. 5.4
Iron, Total EPA 200.7 Rev. 4.4
Lead, Total EPA 200.8 Rev. 5.4
Manganese, Total EPA 200.7 Rev. 4.4
Mercury, Total EPA 245.1 Rev. 3.0
Selenium, Total EPA 200.8 Rev. 5.4
Silver, Total EPA 200.7 Rev. 4.4
Zinc, Total EPA 200.7 Rev. 4.4



Serial No.: 70111

Property of the New York State Department of Health. Certificates are valid only at the address shown and must be conspicuously posted by the laboratory. Continued accreditation depends on the laboratory's successful ongoing participation in the Program. Consumers may verify a laboratory's accreditation status online at <https://apps.health.ny.gov/pubdoh/applinks/wc/elappublicweb/>, by phone (518) 485-5570 or by email to elap@health.ny.gov.

